
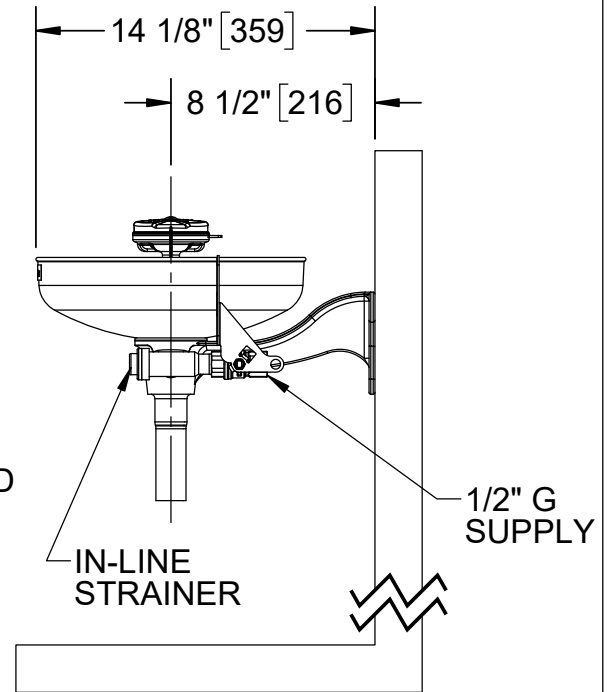
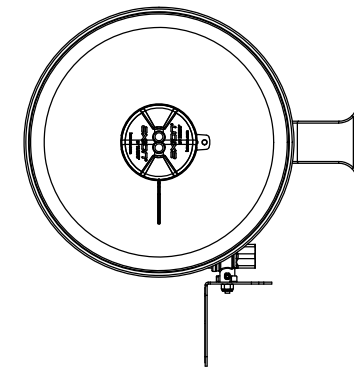
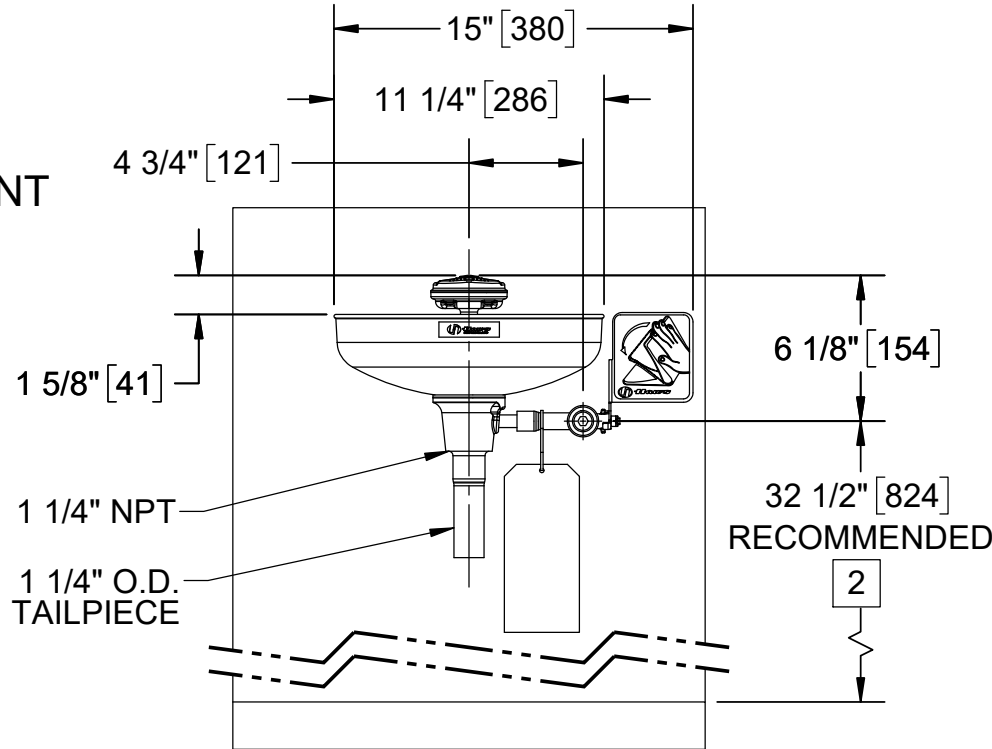


WALL MOUNT DETAIL

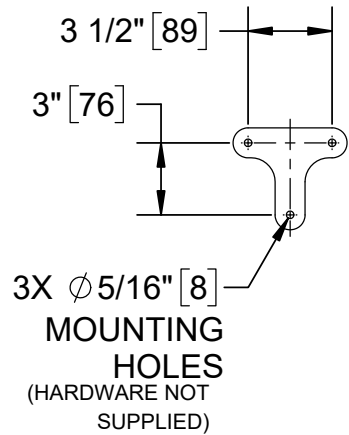

NOTES:

1. WHEN INSTALLING THIS UNIT, LOCAL CODES SHOULD BE ADHERED TO FOR INSTALLATION DIMENSIONS (LOCATIONS), WASTE AND SUPPLY REQUIREMENTS OTHER THAN SHOWN.

2. TO COMPLY WITH ANSI Z358.1-2014 FOR EMERGENCY EYEWASH OR EYE/FACE WASH: EYEWASH OR EYE/FACE WASH SHALL BE POSITIONED SUCH THAT FLUSHING FLUID PATTERN IS NOT LESS THAN 33" (838mm) AND NO GREATER THAN 53" (1346 mm) FROM SURFACE ON WHICH USER STANDS; AND 6.0" (153mm) MINIMUM FROM WALL OR NEAREST OBSTRUCTION .

TO COMPLY WITH DIN EN 15154-2 FOR PLUMBED-IN EYEWASH: EYEWASH SHALL BE POSITIONED SUCH THAT OUTLET NOZZLES ARE NOT LESS THAN 31.5" (800mm) AND NO GREATER THAN 47.24" (1200 mm) FROM SURFACE ON WHICH USER STANDS; AND 5.9" (150mm) MINIMUM FROM WALL OR NEAREST OBSTRUCTION.

3. DIMENSIONS MAY VARY BY ±1/2" (13 mm).

4. DIMENSIONS IN BRACKETS, IN DRAWING SPACE, ARE METRIC [mm].



HAWS AG
BACHWEG 3
3400 BURGDORF SWITZERLAND
T +41 (0)34 420 60 00 F +41 (0)34 420 60 01
E-MAIL: INFO@HAWS.CH
WEBSITE: WWW.HAWS.CH

ECN: 0001	REV. ECN:	BY: IR	MODEL(S)	PART NUMBER
DRAWN: IR	DATE:	CHKD: IR	7260B AXION (10004428)	02080038.D
APPROVED: IR	DATE: 11/12/2024	SCALE: 1:2.5	DRAWING TYPE: INSTALLATION	REVISION 1
			SIZE: A	SHEET 1 OF 1